


P635JH P935JH


35kV Disconnectable "H" Bus

Product Data Sheet

The Richards Disconnectable Joint system is a multi-way medium voltage cable splicing system available through 35kV. Commonly found in higher load density underground systems, these Joints can be useful even for lighter loads due to their versatility and simplicity. Other methods involve complicated installations that are extremely difficult in congested underground distribution environments.

The Disconnectable Joint Bus is composed of a high-conductivity metallic bus contact overmolded with EPDM rubber. The various positions of the Bus allow for interconnection of medium voltage cables in an ultra-low-profile configuration. Accessories are also available for insulating, isolating, spiking and grounding..

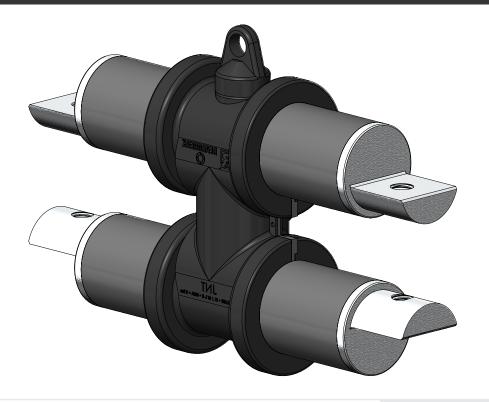

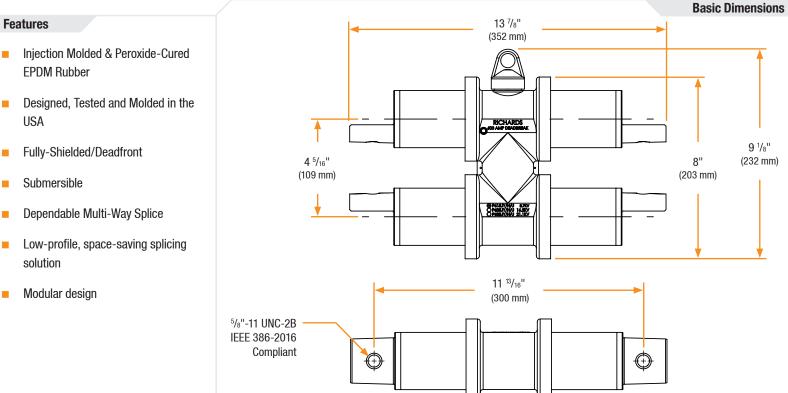

0822



35kV Disconnectable "H" Bus

Related Products			
2 <mark>635JS</mark> 5kV Disconnectable Joint ileeve	P635JSCS 35kV JSCS Series Cold Shrink Sleeve		— Test Point
9 <mark>3DSS0</mark> 15/25/28/35kV Spiking Stem Assembly		EPDM Insulation	IEEE 386-2 Interface 16
P635JIC 35kV Joint Insulating Cap	P6JGP 35kV Joint Grounding Plug		
P6JPB Barrier Bolt		Threaded Hole	Grounding Eye Integral to Rubber Jacket
P6AL-X Aluminum Compression Lug	P9CU-X Copper Compression Lug		
P6ALR-X Aluminum Range Taking Lug	P7ALCU-X Copper-Top Compression Lug	Spa	ade
		Jacket	
Restraints & Tools			
Restraints & Tools Compatible with the followi	ng restraints:		Product Ratings
	ng restraints: JRF	Voltage Ratings	Product Ratings
Compatible with the followi JRI	JRF	Voltage Ratings Maximum Voltage Rating – (phase to ground)	Product Ratings
Compatible with the followi	JRF		
Compatible with the followi JRI Compatible with the followi	JRF ng tools:	Maximum Voltage Rating – (phase to ground)	21.1kV
Compatible with the followi JRI Compatible with the followi P6JAT1	JRF ng tools:	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage)	21.1kV 26kV
Compatible with the followi JRI Compatible with the followi P6JAT1 Production Testing	JRF ng tools: P6JAT3	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage) AC Withstand – (1 minute) Impulse-Withstand Voltage – (BIL)	21.1kV 26kV 50kV
Compatible with the followi JRI Compatible with the followi P6JAT1 Production Testing EEE requires a Partial Disch	JRF ng tools:	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage) AC Withstand – (1 minute) Impulse-Withstand Voltage – (BIL) Continuous Current Ratings	21.1kV 26kV 50kV 162kV BIL R
Compatible with the followi JRI Compatible with the followi P6JAT1 Production Testing IEEE requires a Partial Disch withstand and Impulse. Richards runs 3/3 tests on al	JRF ng tools: P6JAT3	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage) AC Withstand – (1 minute) Impulse-Withstand Voltage – (BIL)	21.1kV 26kV 50kV
Compatible with the followi JRI Compatible with the followi P6JAT1 Production Testing IEEE requires a Partial Disch withstand and Impulse. Richards runs 3/3 tests on all by IEEE 386.	JRF ng tools: P6JAT3 harge test and choice between AC / Medium Voltage products governed	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage) AC Withstand – (1 minute) Impulse-Withstand Voltage – (BIL) Continuous Current Ratings Aluminum	21.1kV 26kV 50kV 162kV BIL R 600A
Compatible with the followi JRI Compatible with the followi P6JAT1 Production Testing IEEE requires a Partial Disch withstand and Impulse. Richards runs 3/3 tests on all by IEEE 386.	JRF ng tools: P6JAT3 harge test and choice between AC / Medium Voltage products governed	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage) AC Withstand – (1 minute) Impulse-Withstand Voltage – (BIL) Continuous Current Ratings Aluminum Copper Short-Time Current Ratings	21.1kV 26kV 50kV 162kV BIL R 600A
Compatible with the followi JRI Compatible with the followi P6JAT1 Production Testing EEE requires a Partial Disch withstand and Impulse. Richards runs 3/3 tests on all by IEEE 386. 100% Routine Electrical Test Partial Discharge	JRF ng tools: P6JAT3 harge test and choice between AC / Medium Voltage products governed	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage) AC Withstand – (1 minute) Impulse-Withstand Voltage – (BIL) Continuous Current Ratings Aluminum Copper Short-Time Current Ratings Aluminum 25k	21.1kV 26kV 50kV 162kV BIL ^ℝ 600A 900A
Compatible with the followi JRI Compatible with the followi P6JAT1 Production Testing IEEE requires a Partial Disch withstand and Impulse. Richards runs 3/3 tests on all by IEEE 386.	JRF ng tools: P6JAT3 harge test and choice between AC / Medium Voltage products governed	Maximum Voltage Rating – (phase to ground) Corona Voltage Level – (partial discharge extinction voltage) AC Withstand – (1 minute) Impulse-Withstand Voltage – (BIL) Continuous Current Ratings Aluminum Copper Short-Time Current Ratings Aluminum 254	21.1kV 26kV 50kV 162kV BIL R 600A 900A 900A

DS-35JH [C]

0822